

# CONSTRUCTION PLANS FOR: MILTON DRINKING WATER SYSTEM IMPROVEMENTS NON-OCRA DIVISION

## MILTON, INDIANA 47357

### PLANS PREPARED FOR:

TOWN OF MILTON  
101 NORTH CENTRAL AVE  
MILTON, IN 47357  
TELEPHONE: (765) 478-3818  
CONTACT PERSON: TERRY CRAIG, CLERK TREASURER  
TCRAIG1325@AOL.COM

### PLANS PREPARED BY:

RQAW CORPORATION  
8770 NORTH STREET, SUITE 110  
FISHERS, INDIANA 46038  
TELEPHONE: (317) 588-1772  
CONTACT PERSON: AARON CROW  
EMAIL: ACROW@RQAW.COM



**SITE VICINITY MAP**  
NOT TO SCALE

SHEET INDEX :	
SHEET #	SHEET NAME
G001	TITLE SHEET
G002	GENERAL NOTES
C400	LEAD SERVICE LINE REPLACEMENT DETAIL
C401	EXISTING METERED SERVICES LIST

REVISIONS :		
REVISION #	REVISION DESCRIPTION	DATE

### OPERATING AUTHORITIES

**SANITARY SEWER**  
MILTON UTILITIES  
101 NORTH CENTRAL AVE  
MILTON, IN 47357  
TELEPHONE: (765) 478-3818  
BRUCE PRICE

**STORM SEWER**  
MILTON UTILITIES  
101 NORTH CENTRAL AVE  
MILTON, IN 47357  
TELEPHONE: (765) 478-3818


**WATER**  
MILTON UTILITIES  
101 NORTH CENTRAL AVE  
MILTON, IN 47357  
TELEPHONE: (765) 478-3818  
BRUCE PRICE

**ELECTRIC**  
DUKE ENERGY  
4632 GATES RD  
CENTERVILLE, IN 47330  
TELEPHONE: (800) 521-2232

**GAS**  
CENTERPOINT ENERGY  
2150 HINES RD  
MUNCIE, IN 47302  
TELEPHONE: (800) 227-1376

**COMMUNICATIONS**  
FRONTIER  
1191 RICH RD  
RICHMOND, IN 47374  
TELEPHONE: (765) 270-2220

**COMMUNICATIONS**  
COMCAST  
4706 NATIONAL RD E  
RICHMOND, IN 47374  
TELEPHONE: (800) 934-6489

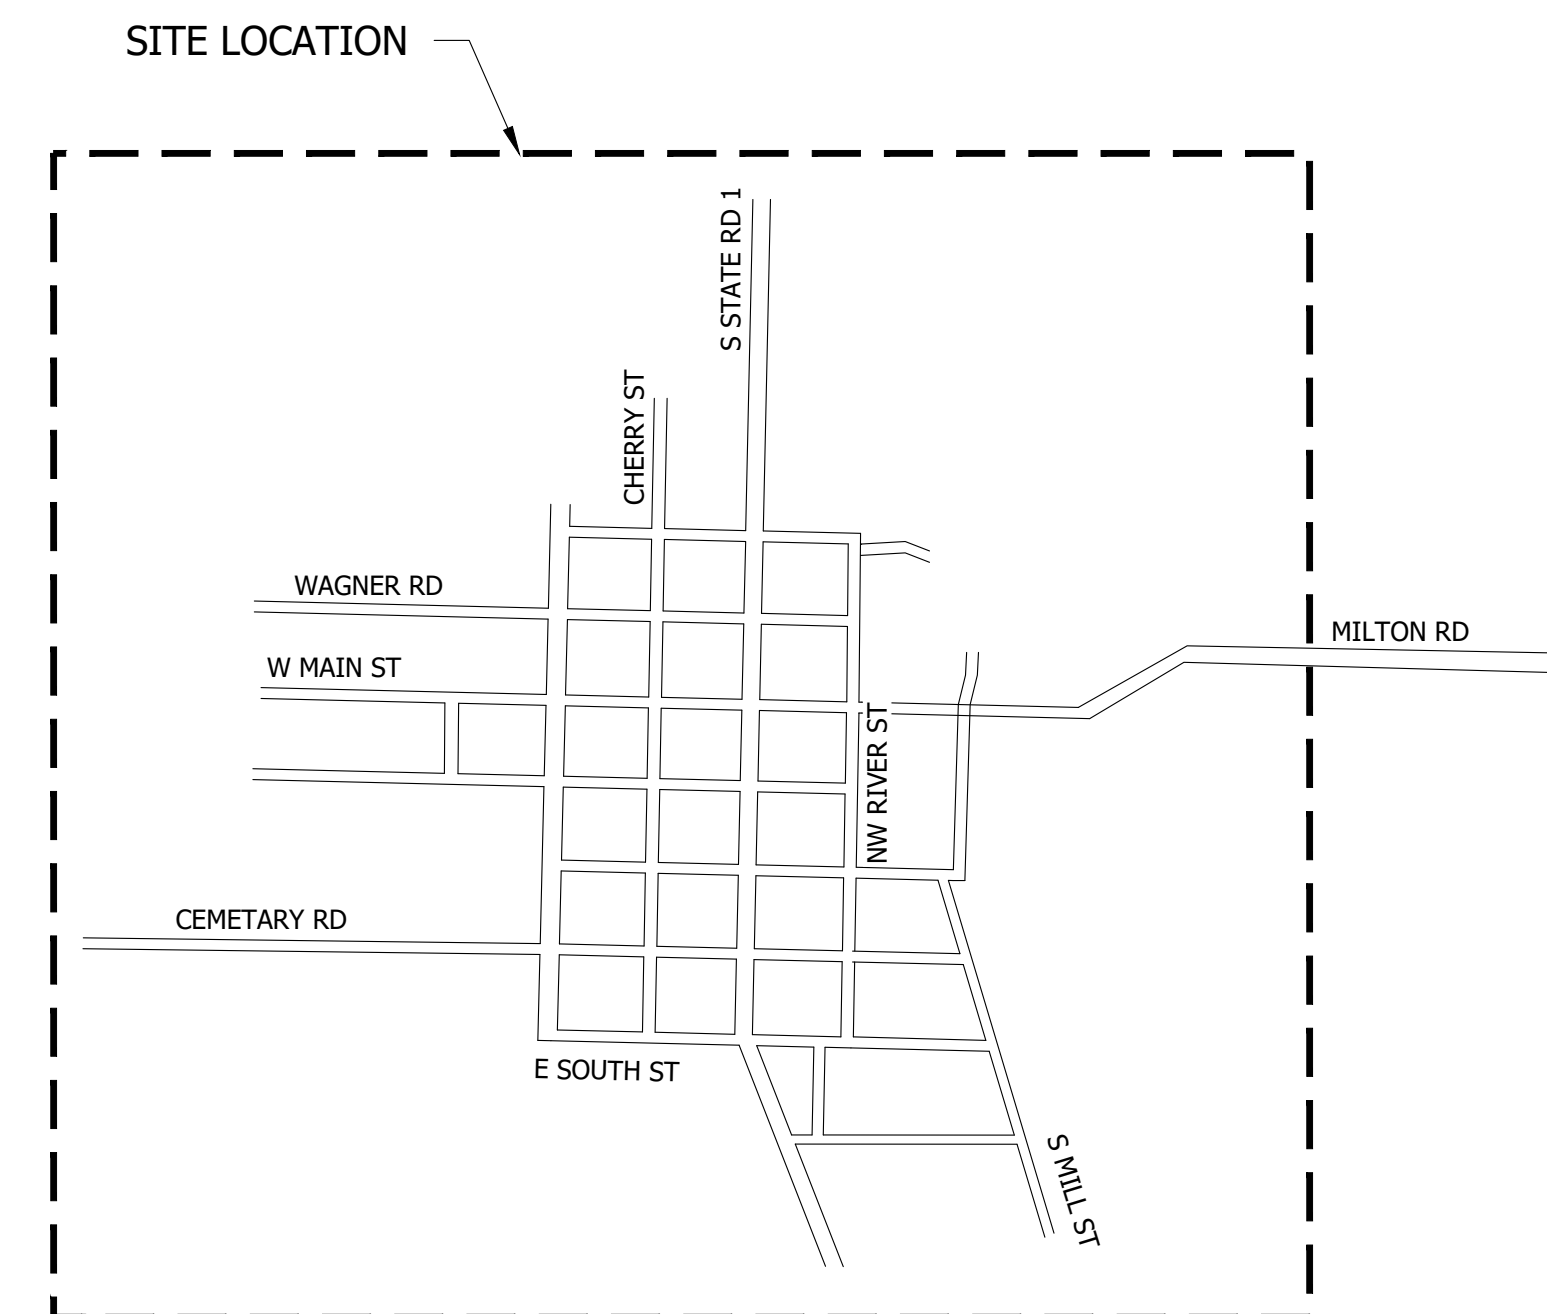

**SITE LOCATION MAP**  
NOT TO SCALE

**FLOOD NOTE:**  
THE ACCURACY OF ANY FLOOD HAZARD DATA SHOWN ON THESE PLANS IS SUBJECT TO MAP SCALE UNCERTAINTY AND TO ANY OTHER UNCERTAINTY IN LOCATION OR ELEVATION ON THE REFERENCED FLOOD INSURANCE RATE MAP. THE WITHIN DESCRIBED TRACT OF LAND LIES WITHIN FLOOD HAZARD ZONE AE AS SAID TRACT PLOTS BY SCALE ON COMMUNITY PANEL NUMBER 0217E DATED 04/02/2015 FOR THE FLOOD INSURANCE RATE MAPS FOR WAYNE COUNTY, INDIANA (UNINCORPORATED AREAS 180592).

**DISCLAIMER:**  
EXISTING CONDITIONS/SURVEY INFORMATION PROVIDED BY COOR CONSULTING. RQAW IS NOT RESPONSIBLE FOR THE ACCURACY OF THE EXISTING CONDITION/SURVEY INFORMATION PROVIDED. CONTRACTOR TO FIELD VERIFY LOCATION AND SIZES OF ALL EXISTING UTILITIES PRIOR TO CONSTRUCTION AND CONTACT ENGINEER AND OWNER IF DISCREPANCIES OCCUR.



CALL 2 WORKING DAYS BEFORE YOU DIG  
**1-800-382-5544**  
CALL TOLL FREE  
PER INDIANA STATE LAW IC8-1-26.  
IT IS AGAINST THE LAW TO EXCAVATE WITHOUT  
NOTIFYING THE UNDERGROUND LOCATION SERVICE  
TWO (2) WORKING DAYS BEFORE COMMENCING WORK.

#	REVISION	DATE

PROJECT #: 22-400-230-1  
DESIGNED BY: WMW  
DRAWN BY: RLH  
CHECKED BY: ALC  
DATE: 04/24/2023

**AARON L. CROW**  
REGISTERED  
No. PE11800762  
STATE OF INDIANA  
PROFESSIONAL ENGINEER  
*Aaron Crow*

PRINT DATE: 7/10/23  
PLOT SCALE: 1:186.91  
DRAWING FILE: P:\22-400-230-1 MILTON DRINKING WATER\ACAD\NON-OCRA DIVISION\PLAN SHEETS & WORKING DRAWINGS\G001 TITLE SHEET.DWG  
EDIT DATE: 4/11/23 - 3:06 PM  
EDITED BY: RHUNT

**MILTON DRINKING WATER  
SYSTEM IMPROVEMENTS  
NON-OCRA DIVISION**  
 MILTON, IN 47357

CONSTRUCTION SET

#	REVISION	DATE

PROJECT #: 22-400-230-1  
 DESIGNED BY: WMW  
 DRAWN BY: RLH  
 CHECKED BY: ALC  
 DATE: 04/24/2023



*Aaron Crow*

**GENERAL NOTES**

**G002**

- GENERAL NOTES**
- ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE CONTRACT DOCUMENTS FOR THIS PROJECT. ADDITIONS, DELETIONS, AND/OR REVISIONS SHALL NOT BE MADE WITHOUT PRIOR APPROVAL BY THE ENGINEER. KEEP AND MAINTAIN IN GOOD CONDITION A COMPLETE SET OF THE CONTRACT DOCUMENTS ON THE JOB SITE AT ALL TIMES.
  - ALL WORK SHALL COMPLY WITH LOCAL, STATE, AND FEDERAL CODES, ORDINANCES, RULES, REGULATIONS, ORDERS, AND OTHER LEGAL REQUIREMENTS OF AUTHORITIES HAVING JURISDICTION.
  - IN THE EVENT THAT THE CONTRACTOR DISCOVERS A DISCREPANCY IN THE CONTRACT DOCUMENTS OR POTENTIAL UTILITY CONFLICT, NOTIFY THE ENGINEER IMMEDIATELY FOR CLARIFICATION PRIOR TO PROCEEDING WITH THE CONSTRUCTION OF THE PORTION OF THE WORK IN QUESTION. FIELD LOCATE ALL EXISTING UTILITIES PRIOR TO CONSTRUCTION. VERTICAL AND HORIZONTAL LOCATIONS TO BE CONFIRMED. ANY NECESSARY PIPE MODIFICATIONS SHALL BE MADE BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE OWNER.
  - CONSTRUCTION SHALL NOT COMMENCE UNTIL ALL LOCAL NECESSARY PERMITS HAVE BEEN OBTAINED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING, OR VERIFYING, THAT ALL PERMITS AND APPROVALS ARE OBTAINED FROM THE RESPECTIVE CITY, COUNTY, AND STATE AGENCIES PRIOR TO STARTING CONSTRUCTION.
  - ALL RIGHT-OF-WAY AND PROPERTY LINES AND EASEMENTS ARE APPARENT AND WERE DETERMINED BASED UPON AVAILABLE INFORMATION. VERIFY ALL RIGHT-OF-WAY AND PROPERTY LINES. STAKE ALL RIGHT-OF-WAY, PROPERTY, AND EASEMENT LINES THROUGHOUT THE DURATION OF CONSTRUCTION.
  - CONSTRUCTION STAKING SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. PROPERTY LINES AND RIGHT-OF-WAY SHALL BE STAKED FOR THE DURATION OF CONSTRUCTION ACTIVITIES.
  - PROTECT ALL EXISTING UTILITIES FROM DAMAGE, IN A MANNER APPROVED BY THE UTILITY COMPANIES AND THE ENGINEER. COORDINATE WITH UTILITY COMPANIES AS NECESSARY TO COMPLETE THE WORK. PROTECT BENCH MARKS, SURVEY CONTROL POINTS, AND EXISTING STRUCTURES FROM UNNECESSARY DAMAGE OR DISPLACEMENT.
  - PROVIDE ALL AUTOMOBILE AND PEDESTRIAN TRAFFIC CONTROL DEVICES REQUIRED BY FEDERAL, STATE, OR LOCAL AGENCIES. THE AMOUNT, LOCATION, AND SIZE SHALL BE AS REQUIRED IN ACCORDANCE WITH MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES.
  - DURING CONSTRUCTION IT MAY BE NECESSARY TO TRIM OR REMOVE A TREE WITHIN THE RIGHT-OF-WAY OR AN EASEMENT. NOTIFY THE ENGINEER, OWNER, AND ANY AFFECTED PROPERTY OWNER PRIOR TO ANY REQUIRED TREE REMOVAL. TREE TRIMMING AS REQUIRED WITHIN THE RIGHT-OF-WAY OR EASEMENT SHALL BE MINIMIZED. NO ADDITIONAL COMPENSATION WILL BE PROVIDED FOR TREE REMOVAL OR TRIMMING.
  - ALL DISTURBED AREAS, INCLUDING, BUT NOT LIMITED TO, STREETS, DRIVES, WALKS, LAWNS, FENCES, RETAINING WALLS, ETC. SHALL BE RESTORED TO ORIGINAL OR BETTER CONDITION.
  - IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO REMOVE ALL MUD, DIRT, GRAVEL, AND ANY OTHER MATERIALS TRACKED ONTO ANY PUBLIC OR PRIVATE STREETS, PARKING LOTS, OR WALKS. THIS MATERIAL REMOVAL OR SWEEPING OF THE STREETS SHALL BE DONE AS FREQUENTLY AS NECESSARY TO MAINTAIN AREAS REASONABLY CLEAN. AIRBORNE DUST SHALL BE KEPT TO A MINIMUM BY USING WATER OR OTHER METHODS AS NECESSARY.
  - PROVIDE TEMPORARY GRASS SEED WITHIN 7-DAYS OF ALL EARTH DISTURBING ACTIVITIES.
  - PROVIDE AND MAINTAIN ALL NECESSARY STRAW BALES, FILTER FENCE, INLET PROTECTION ETC. IN EXISTING AND PROPOSED DITCHES, CULVERTS, STORM PIPES, AND DRAINAGE STRUCTURES TO PREVENT DAMAGE. BIO-DEGRADABLE EROSION CONTROL DEVICES SHOULD BE PLACED IN ALL DISTURBED DRAINAGE DITCHES WITH DEPTHS GREATER THAN 12".
  - REGRADE AREAS AS NECESSARY WITHIN THE CONSTRUCTION LIMITS TO ALLOW PROPER DRAINAGE TO EXISTING STORM SEWER STRUCTURES.
  - MAINTAIN 10'-0" HORIZONTAL AND 1'-6" VERTICAL SEPARATION FROM STORM AND SEWER MAIN, UNLESS SPECIFICALLY NOTED IN THE PLANS.
  - PROVIDE FILL AROUND PROPOSED AND EXISTING PIPING AT ALL OPEN-CUT UTILITY CROSSINGS TO ADEQUATELY SUPPORT AND PROTECT EACH CONDUIT.
  - PRESERVE EXISTING RIGHT-OF-WAY MARKERS. IF RIGHT-OF-WAY MARKERS ARE DISTURBED, RESET MARKERS AT NO ADDITIONAL COST TO THE OWNER.
  - CALL LOCAL UTILITY LINE INFORMATION SERVICE NOT LESS THAN THREE WORKING DAYS BEFORE PERFORMING WORK. REQUEST UNDERGROUND UTILITIES TO BE LOCATED AND MARKED WITHIN AND SURROUNDING CONSTRUCTION AREAS. IDENTIFY REQUIRED LINES, LEVELS, CONTOURS, AND DATUM LOCATIONS.
  - ESTABLISH TEMPORARY TRAFFIC CONTROL LAND DETOURS WHEN TRENCHING IS PERFORMED IN PUBLIC RIGHT-OF-WAY. RELOCATE CONTROLS AND REROUTE TRAFFIC AS REQUIRED DURING PROGRESS OF WORK.
  - DO NOT LEAVE MORE THAN 50 FEET OF TRENCH OPEN AT END OF WORKING DAY. PROTECT OPEN TRENCH TO PREVENT DANGER TO THE PUBLIC.
  - STOCKPILE EXCAVATED AND FILL MATERIALS ON SITE AT LOCATIONS APPROVED BY OWNER. STOCKPILE IN SUFFICIENT QUANTITIES TO MEET PROJECT SCHEDULE AND REQUIREMENTS. SEPARATE DIFFERENT AGGREGATE MATERIALS WITH DIVIDERS OR STOCKPILE QUANTITIES TO MEET PROJECT SCHEDULE AND REQUIREMENTS, SEPARATE DIFFERENT AGGREGATE MATERIALS WITH DIVIDERS OR STOCKPILE INDIVIDUALLY TO PREVENT MIXING. DIRECT SURFACE WATER AWAY FROM STOCKPILE SITE TO PREVENT EROSION OR DETERIORATION OF MATERIALS. STOCKPILE CLEANUP: REMOVE STOCKPILE, AND LEAVE AREA IN CLEAN AND NEAT CONDITION. GRADE SITE SURFACE TO PREVENT FREE STANDING SURFACE WATER.
  - FINAL CONTOURS: PERFORM FINISH GRADING AND BLEND INTO CONFIRMATION WITH REMAINING NATURAL GROUND SURFACES. LEAVE ALL FINISHED GRADING SURFACES SMOOTH AND FIRM TO DRAIN. FINISH GRADES TO ELEVATIONS WITHIN PLUS OR MINUS 0.10 FOOT OF EXISTING OR CONTOUR SHOWN.
  - ALL ELEVATIONS AT CONSTRUCTION LIMITS SHALL MATCH EXISTING GRADE. CONTRACTOR SHALL BE RESPONSIBLE FOR ENSURING THAT STACKED GRADES MATCH DESIGN ELEVATIONS AND POSITIVE DRAINAGE TO STORMWATER MANAGEMENT SYSTEM IS ACHIEVED. CONTACT ENGINEER IF DESIGN ELEVATIONS DO NOT PROVIDE POSITIVE DRAINAGE.
  - ALL CONNECTIONS TO EXISTING MAIN SHOULD BE MADE VIA DRY TAP WHEREVER POSSIBLE. CONTRACTOR TO COORDINATE ISOLATION AND CONNECTIONS WITH TOWN. WET TAPS MAY BE REQUIRED IN SOME AREAS, COORDINATE WITH TOWN TO DETERMINE CONNECTION METHOD.
  - REPLACED MAIN IS TO BE CAPPED AND ABANDONED IN PLACE. FLOWABLE FILL SHALL BE USED IN ABANDONED MAIN UNDER CROSSINGS OF STATE ROAD 1.

LINE TYPE	CIVIL TYPE
	CONSTRUCTION LIMITS
	SET BACK
	RIGHT OF WAY
	SILT FENCE
	HAY BALE/ ROCK CHECK DAM
	EASEMENT
	PROPERTY LINE
	EXISTING MAJOR CONTOURS
	EXISTING MINOR CONTOURS
	EXISTING FIBER OPTIC
	EXISTING SANITARY SEWER
	EXISTING STORM SEWER
	EXISTING WATER MAIN
	EXISTING OVERHEAD ELECTRIC
	EXISTING ELECTRIC
	EXISTING TELEPHONE
	EXISTING GAS LINE
	EXISTING FENCE
	TREE LINE
	EXISTING COMMUNICATIONS CABLE
	PROPOSED SANITARY SEWER
	PROPOSED STORM SEWER
	PROPOSED WATER MAIN
	PROPOSED WATER MAIN - SEE REF.
	PROPOSED MAJOR CONTOURS
	PROPOSED MINOR CONTOURS
LINE TYPE	PROCESS TYPE
	SLUDGE BLOWDOWN
	RAW WATER
	FINISHED WATER
	BACKWASH SUPPLY
	FILTERED WASTEWATER

SYMBOLS	
	STREET LIGHTING PULL BOX
	TRAFFIC SIGNAL POST
	BOLLARD
	PHONE MANHOLE
	ROOF DRAIN
	SIGN
	TREE
	SANITARY CLEANOUT
	STORM CATCH BASIN
	RESIDUALS MANHOLE
	SANITARY MANHOLE
	STORM MANHOLE
	POWER POLE
	ELECTRIC MANHOLE
	ELECTRIC METER
	WATER VALVE
	FIRE HYDRANT
	GAS VALVE
	GAS METER
	SET 5/8" IRON ROD CAPPED
	FOUND 1" IRON PIPE SET
	'MAG' NAIL
	CUT CROSS
	( R ) RECORD
	( M ) MEASURE
	( C ) CALCULATED
	MAILBOX
	YARD HYDRANT
	CONCRETE WASHOUT
	GATE VALVE
	BUTTERFLY VALVE
	CHECK VALVE
	AIR RELEASE VALVE
	BALL VALVE
	PRESSURE RELIEF VALVE
	BACK PRESSURE VALVE
	SOLENOID VALVE
	PULSATIPON DAMPER
	PUMP
	ISOLATOR
	QUICK CONNECT ADAPTER
	INJECTOR
	STATIC MIXER
	PRESSURE GAUGE
	PRESSURE SWITCH
	PRESSURE TRANSDUCER
	LEVEL PROBE
	STRANER
	FLOW METER
	SLIDE GATE
	NON-MODULATING ACTUATOR
	MODULATING ACTUATOR
	FLAP GATE
	FLEX COUPLING
	FLEX TUBING
	REDUCER/INCREASER
	BOOSTER PUMP
	TIDFLEX VALVE

ABBREVIATIONS			
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
AFF	ABOVE FINISHED FLOOR	FCO	FLOOR CLEANOUT
ATR	ALL THREAD ROD	GV	GATE VALVE
AS	AQUASTAT	GLV	GLOBE VALVE
AAV	AIR ADMITTANCE VALVE	HSP	HIGH SERVICE PUMP
AC	AIR COMPRESSOR	HB	HOSE BIBB
ARV	AIR RELEASE VALVE	HWRP	HOT WATER RETURN PUMP
AP	ACCESS PANEL	MV	MANUAL AIR VENT
AD	AREA DRAIN	M	MOTOR - OPERATED VALVE
AV	ANGLE VALVE	ORD	OVERFLOW ROOF DRAIN
AUV	AUTOMATIC AIR VENT	PTU	PACKAGED TREATMENT UNIT
BV	BALL VALVE	PV	PLUG VALVE
BFV	BUTTERFLY VALVE	PA	PIPE ANCHOR
BFP	BACKFLOW PREVENTER ASSEMBLY	PG	PIPE GUIDE
BS	BASKET STRAINER	PS	PIPE SLEEVE
CTLV	CONTROL VALVE, 2-WAY	PRV	PRESSURE RELIEF VALVE
CV	CHECK VALVE	PIV	POST INDICATOR VALVE
CR	CONCENTRIC REDUCER/INCREASER	PG	PRESSURE GAUGE WITH GAUGE COOK
DU	DIELECTRIC UNION	PS	PRESSURE SWITCH
DBL	DOUBLE	ROW	RIGHT OF WAY
ECO	EXTERIOR CLEANOUT (TO GRADE)	RD	ROOF DRAIN
EL	EXPANSION LOOP (SIZE AS NOTED)	SV	SOLENOID VALVE
EC	ECCENTRIC REDUCER/INCREASER	TPV	TEMPERATURE- PRESSURE RELIEF VALVE
EJ	EXPANSION JOINT	T	THERMOMETER (SPECIFY TYPE)
FFE	FINISHED FLOOR ELEVATION	U	UNION
F	FLANGE	WCO	WALL CLEANOUT
FS	FLOW SWITCH	WHA	WATER HAMMER ARRESTOR
FM	FLOW METER	WS	WYE STRANNER
FC	FLEXIBLE CONNECTOR	WH	WALL HYDRANT
FD	FLOOR DRAIN	YB	YARD BOX


**GENERAL NOTES**

**HOMEOWNER COORDINATION:**

1. RIGHT-OF-ENTRY (ROE) IS REQUIRED PRIOR TO ENTRY OF ANY PRIVATELY OWNED PROPERTY TO DO WORK. ROE WILL BE SECURED AND PROVIDED BY THE TOWN.
2. CONTRACTOR SHALL WORK WITH TOWN TO ADDRESS COMMUNICATIONS TO TOWN CUSTOMERS WHICH INCLUDES BUT IS NOT LIMITED TO:
  - a. CONTRACTOR TO FIRST NOTIFY EACH HOMEOWNER OF WORK SCHEDULED AT THEIR PROPERTY 2 WEEKS PRIOR.
  - b. CONTRACTOR TO SEND REMINDER NOTIFICATION TO EACH HOMEOWNER AT LEAST 3 DAYS PRIOR TO WORK.
3. ENSURE COMPANY VEHICLES, UNIFORMS, AND OTHER SIGNAGE TO IDENTIFY CONTRACTORS IS PRESENT FOR HOMEOWNERS.

**PROJECT CONSIDERATIONS:**

1. CONTRACTOR SHALL FOLLOW ALL AWWA STANDARDS FOR SERVICE LINE REPLACEMENT INCLUDING AWWA C800-21 UNDERGROUND SERVICE LINE VALVES AND FITTINGS AND AWWA C810-17 REPLACEMENT AND FLUSHING OF LEAD SERVICE LINES. CONTRACTOR TO FOLLOW THESE STANDARDS FOR ALL PIPE MATERIAL TYPES.
2. CONTRACTOR SHALL FOLLOW ALL GUIDELINES OF THE UNIFORM PLUMBING CODE DURING INSTALLATION.
3. COMPLIANCE WITH NSF/ANSI 61 IS REQUIRED.
4. REPLACEMENT OF LEAD AND GALVANIZED STEEL SERVICE LINES MUST BE MADE FROM NEWLY INSTALLED METER PIT (WORK DONE BY OTHERS AS A PART OF MILTON DRINKING WATER SYSTEM IMPROVEMENTS PROJECT) OR EXISTING METER PIT TO PREMISE PLUMBING OF HOME. CONTRACTOR MUST COORDINATE WITH CONTRACTOR SELECTED FOR MILTON DRINKING WATER SYSTEM IMPROVEMENTS PROJECT TO DETERMINE SEQUENCING OF SERVICE LINE REPLACEMENTS.
5. CONTRACTOR MUST ALSO COORDINATE THE TERMINATION POINT OF WORK DONE BY OTHERS TO DETERMINE START OF WORK ON IDENTIFIED SERVICE LINES.
6. CONTRACTOR MUST PROVIDE A SUBMITTAL FOR ALL MATERIALS USED TO BE APPROVED BY ENGINEER.
7. ALL PROPERTY DISTURBED BY CONSTRUCTION SHALL BE RESTORED, INCLUDING SEEDING FOR GRASS AREAS ON THE PROPERTY AS WELL AS INTERIOR PORTIONS OF ANY BUILDING ON THE PROPERTY DISTURBED BY WORK.
8. PER INDIANA STATE CODE, A LICENSED, BONDED PLUMBER IS REQUIRED TO MAKE PLUMBING CONNECTIONS.
9. DISPOSE OF ALL LEAD SERVICE LINES IN A SAFE MANNER.

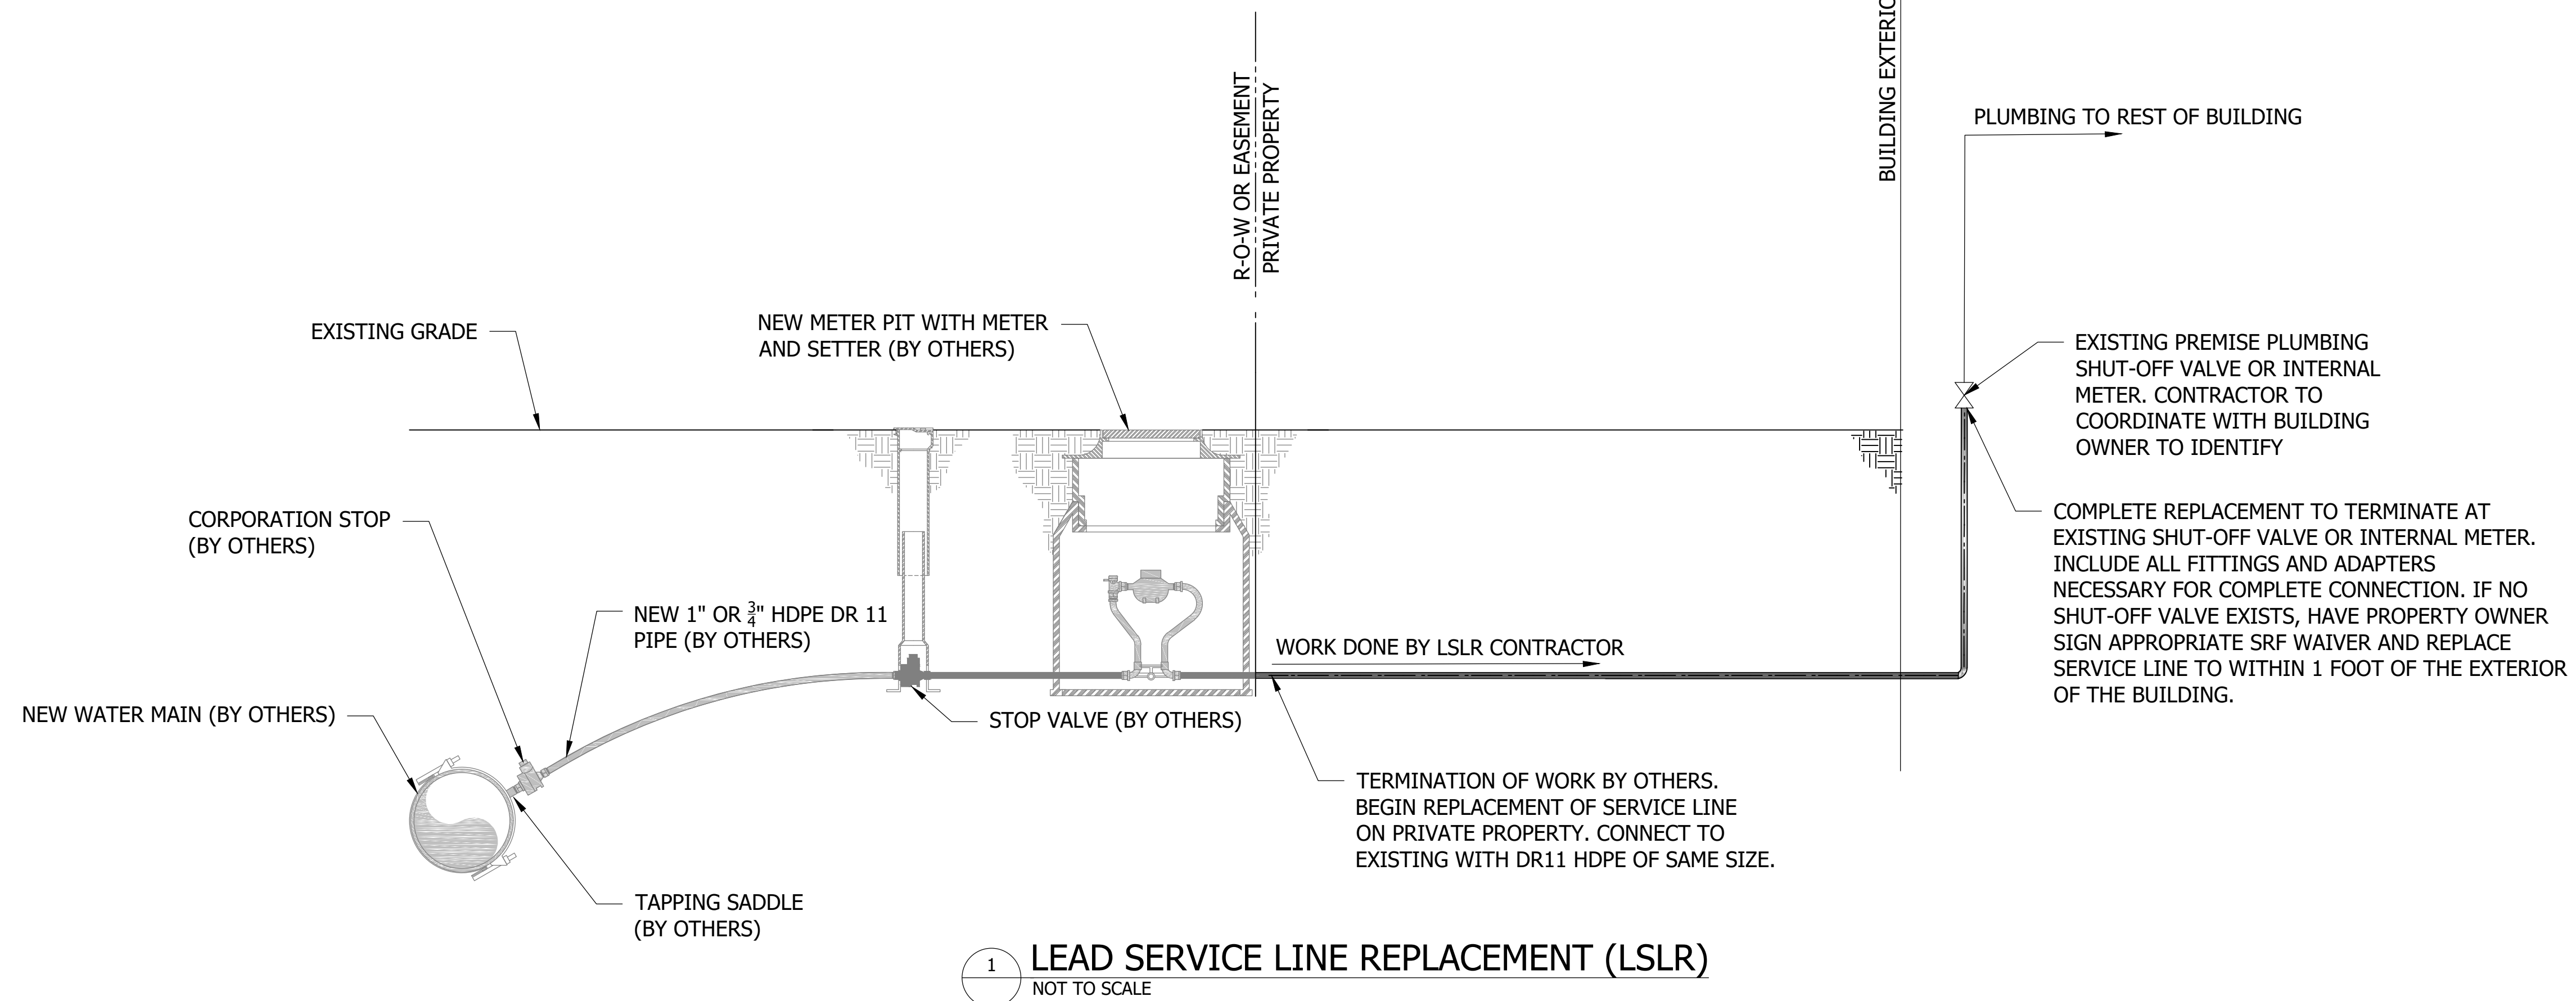


**1 LEAD SERVICE LINE REPLACEMENT (LSLR)**  
NOT TO SCALE

CONSTRUCTION SET

#	REVISION	DATE

PROJECT #: 22-400-230-1  
 DESIGNED BY: WMW  
 DRAWN BY: RLH  
 CHECKED BY: ALC  
 DATE: 04/24/2023

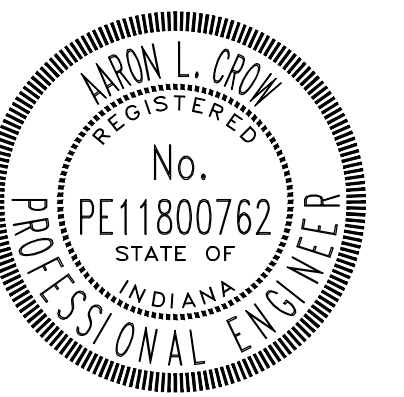

*Aaron Crow*

**LEAD SERVICE LINE  
REPLACEMENT DETAIL**

**C400**

PRINT DATE: 7/10/23 4:14 PM EDITED BY: WMEIDENBENNER DRAWING FILE: P:\22-400-230-1 MILTON DRINKING WATER\ACAD\NON-OCRA DIVISION\PLAN SHEETS & WORKING DRAWINGS\C400 -LSLR DETAIL.DWG  
 PLOT SCALE: 1:186.91




INTENTIONAL INNOVATION

MILTON DRINKING WATER SYSTEM IMPROVEMENTS NON-OCRA DIVISION MILTON, IN 47357

CONSTRUCTION SET

Table with 3 columns: #, REVISION, DATE

PROJECT #: 22-400-230-1
DESIGNED BY: WMW
DRAWN BY: RLH
CHECKED BY: ALC
DATE: 04/24/2023

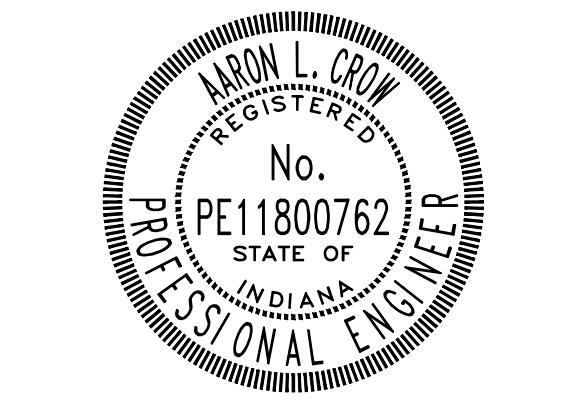

Aaron Crow

EXISTING METERED SERVICES LIST

C401

Table with 4 columns: Address, Service Material, Location Notes, Type. Contains 100 rows of property data.

Table with 4 columns: Address, Service Material, Location Notes, Type. Contains 100 rows of property data.

Table with 4 columns: Address, Service Material, Location Notes, Type. Contains 100 rows of property data.

Table with 4 columns: Address, Service Material, Location Notes, Type. Contains 100 rows of property data.

PRINT DATE: 7/10/23 PLOT SCALE: 1:186.91